

## Test Report

FOR: **dB Noise Reduction**  
Cambridge, Ontario.

**Sound Absorption**  
**RAL™-A15-089a**

CONDUCTED: 2015-04-16

Page 1 of 9

ON: dBNR Nois-eNvelope™ Panel A6 (Perforations Face Source)

### TEST METHOD

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2005 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-09a: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-05(2012): "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measuring procedure and room qualifications is available upon request.

### DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as dBNR Nois-eNvelope™ Panel A6 (Perforations Face Source). A full internal inspection performed on the test specimen by Riverbank personnel verified the manufacturer's description.

#### **Frame**

---

Overall Size: 1.17 m (46.0 in.) x 2.43 m (95.50 in.)  
Overall Thickness: 152.40 mm (6.0 in.)  
Material: Galvannealed steel\*  
Material Thickness 1.21 mm (0.048 in.), 18 gauge

#### **Face Panel (Source Side)**

---

Thickness: 0.89 mm (0.035 in.), 22 gauge  
Material: Galvannealed steel\*  
Perforations: 2.32 mm (0.09 in.) diameter  
60° staggered pitch, 4.45 mm (0.175 in.) on center  
24.6% open area in perforated region  
Fastened: Tongue and groove interlocking joints, soldered to frame  
approximately 101.60 mm (4.0 in.) on center

#### **Rear Panel (Receive Side)**

---

Thickness: 1.22 mm (0.048 in.), 18 gauge  
Material: Galvannealed steel\*  
Fastened: Tongue and groove interlocking joints, soldered to frame  
approximately 152.40 mm (6.0 in.) on center



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

## Test Report

**dB Noise Reduction**  
2015-04-16

**RAL™-A15-089a**  
Page 2 of 9

### Core

Thickness: 152.40 mm (6.0 in.)  
Material: (Source Side)  
75.18 mm (2.96 in.) mineral wool, 4.0 lbs./ft<sup>3</sup>\*  
1.19 mm (0.047 in.) galvanized steel\* septum, 18 gauge  
76.0 mm (3.0 in.) mineral wool, 4.0 lbs./ft<sup>3</sup>\*  
(Receive Side)

\* = Information provided by manufacturer and not verified by RAL.

### Physical Measures

Size: 2.34 m (92.00 in.) wide by 2.43 m (95.50 in.) long  
Thickness: 152.40 mm (6.00 in.)  
Weight: 211.83 kg (467.00 lbs.)  
Mass per Unit Area: 37.35 kg/m<sup>2</sup> (7.65 lbs/ft<sup>2</sup>)  
Area: 5.67 m<sup>2</sup> (61.00 ft<sup>2</sup>)

### Test Environment

Volume: 292.0 m<sup>3</sup> (10,311.0 ft<sup>3</sup>)  
Temperature: 21.6±0.0°C (70.9±0.0°F)  
Humidity: 59.7±0.7%  
Barometric Pressure: 99.2 kPa.



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

**Test Report**

**dB Noise Reduction**  
2015-04-16

**RAL™-A15-089a**  
Page 3 of 9

**PHOTOGRAPH WITHHELD BY DB NOISE REDUCTION  
CONTAINS PROPRIETARY INFORMATION**

Figure 1 – Specimen mounted in the test chamber.

**PHOTOGRAPH WITHHELD BY DB NOISE REDUCTION  
CONTAINS PROPRIETARY INFORMATION**

Figure 2 – Detail of the test specimen.



RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

**Test Report**

**dB Noise Reduction**  
2015-04-16

**RAL™-A15-089a**  
Page 4 of 9

**PHOTOGRAPH WITHHELD BY  
DB NOISE REDUCTION  
CONTAINS PROPRIETARY  
INFORMATION**

Figure 3 – Detail of the insulated core

## Test Report

**dB Noise Reduction**  
2015-04-16

**RAL™-A15-089a**  
Page 5 of 9

### MOUNTING METHOD

Type A Mounting: The test specimen was laid directly against the test surface. The perimeter edges were exposed, as would be typical of an actual installation of this specimen.

### TEST RESULTS

1/3 Octave Center Frequency (Hz)	Total Absorption (SI) (m <sup>2</sup> )	Total Absorption (IP) (Sabins)	Absorption Coefficient (Sabins / ft <sup>2</sup> )
100	4.39	47.21	0.77
** 125	3.53	38.00	0.62
160	3.52	37.91	0.62
200	4.72	50.78	0.83
** 250	5.35	57.57	0.94
315	6.20	66.75	1.09
400	6.39	68.83	1.13
** 500	6.40	68.85	1.13
630	6.28	67.59	1.11
800	6.21	66.85	1.10
** 1000	6.14	66.13	1.08
1250	6.08	65.40	1.07
1600	6.01	64.67	1.06
** 2000	6.16	66.26	1.09
2500	6.18	66.51	1.09
3150	6.14	66.10	1.08
** 4000	6.04	65.00	1.07
5000	6.20	66.74	1.09

**SAA = 1.06**  
**NRC = 1.05**



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE  
GENEVA, IL 60134  
630-232-0104

An  ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

**Test Report**


**dB Noise Reduction**  
2015-04-16

**RAL™-A15-089a**  
Page 6 of 9


TEST RESULTS (Continued)

The sound absorption average (SAA) is defined as a single number rating, the average, rounded to the nearest 0.01, of the sound absorption coefficient of a material for the twelve one-third octave bands from 200 through 2500 Hz, inclusive.

The noise reduction coefficient (NRC) is defined from previous versions of this same test method as the average of the coefficients at 250, 500, 1000, and 2000 Hz, expressed to the nearest integral multiple of 0.05.

Tested by   
Marc Sciaky  
Experimentalist

Report by   
Chris Nottoli  
Acoustician

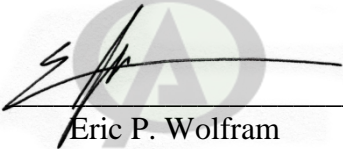Approved by   
Eric P. Wolfram  
Laboratory Manager



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.


THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

Test Report

dB Noise Reduction  
2015-04-16

RAL™-A15-089a  
Page 7 of 9

**SOUND ABSORPTION REPORT**  
dBNR Nois-eNvelope™ Panel A6 (Perforations Face Source)

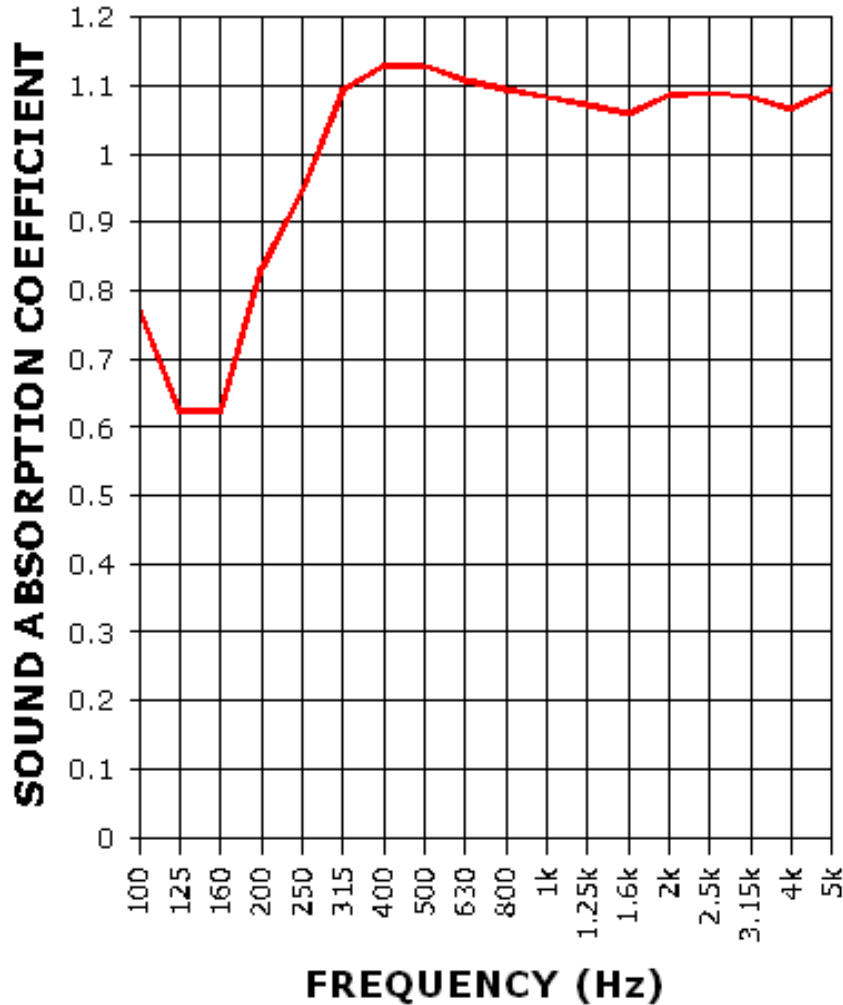

**SAA = 1.06**  
**NRC = 1.05**



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

## Test Report

**dB Noise Reduction**  
 2015-04-16

**RAL™-A15-089a**  
 Page 8 of 9

### **APPENDIX A: Extended Frequency Range Data**

Specimen: dBNR Nois-eNvelope™ Panel A6 (Perforations Face Source) (See Full Report)

*The following non-accredited data were obtained in accordance with ASTM C423-09a, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.*

1/3 Octave Band Center Frequency (Hz)	Total Absorption (Sabins)	Absorption Coefficient (Sabins / ft <sup>2</sup> )
31.5	5.67	0.09
40	15.30	0.25
50	17.59	0.29
63	28.35	0.46
80	27.17	0.45
100	47.21	0.77
125	38.00	0.62
160	37.91	0.62
200	50.78	0.83
250	57.57	0.94
315	66.75	1.09
400	68.83	1.13
500	68.85	1.13
630	67.59	1.11
800	66.85	1.10
1000	66.13	1.08
1250	65.40	1.07
1600	64.67	1.06
2000	66.26	1.09
2500	66.51	1.09
3150	66.10	1.08
4000	65.00	1.07
5000	66.74	1.09
6300	66.77	1.09
8000	70.61	1.16
10000	74.10	1.21
12500	76.72	1.26



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.



1512 S BATAVIA AVENUE  
GENEVA, IL 60134  
630-232-0104

An  ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## Test Report

**dB Noise Reduction**  
2015-04-16

**RAL™-A15-089a**  
Page 9 of 9

### **APPENDIX B: Instruments of Traceability**

Specimen: dBNR Nois-eNvelope™ Panel A6 (Perforations Face Source) (See Full Report)

<b><u>Description</u></b>	<b><u>Model</u></b>	<b><u>Serial Number</u></b>	<b><u>Date of Certification</u></b>	<b><u>Calibration Due</u></b>
Bruel & Kjaer Pulse Analyzer	Type 3560-C	2647140	2015-04-08	2016-04-08
Bruel & Kjaer Mic And Preamp	Type 4943-B-001	2311440	2014-09-03	2015-09-03
G.R.A.S Pistonphone	Type42AF-1	80001	2014-08-06	2015-08-06
Omega Digital Temp., Humid. And Pressure Recorder	OM-CP- PRHTemp2000	N11105	2014-09-30	2015-09-30

---

END



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.